

ASPHALT SHINGLES

_ 15 LBS BUILDING PAPER

_ 5/8" ROOF SHEATHING

EXTERIOR WALL FACE

TO EXT. ELEVATIONS

TO EXT. ELEVATIONS

TO EXT. ELEVATIONS

ELEV. 110'-6"

_ CONT. METAL DRIP EDGE

_ 6" FIBER CEMENT TRIM - REFER

_ 3" FIBER CEMENT TRIM - REFER

_ 12" FIBER CEMENT TRIM - REFER

BRGING HEIGHT ___

_ SELF-ADHERED BITUMINOUS SHEET

UNDERLAYMENT MIN. 36" BACK FROM

WOOD TRUSS - REFER TO -

ALUMINUM SOFFIT ON WD. ---

BLOCKING AS REQUIRED

TRUSS ANCHOR - REFER TO

(2) LAYERS OF 5/8" GYP. BD

(REFER TO 12/A000)

12" UNFACED BATT INSULATION ON —

EAVE VENTALATION TROUGH, WHERE NO ___


5 EAVE DETAIL
SCALE: 3/4"=1'-0"


LVL BLOCKING WAS INSTALLED (TYPICAL)

STRUCTURAL

STRUCTURAL

VAPOR BARRIER

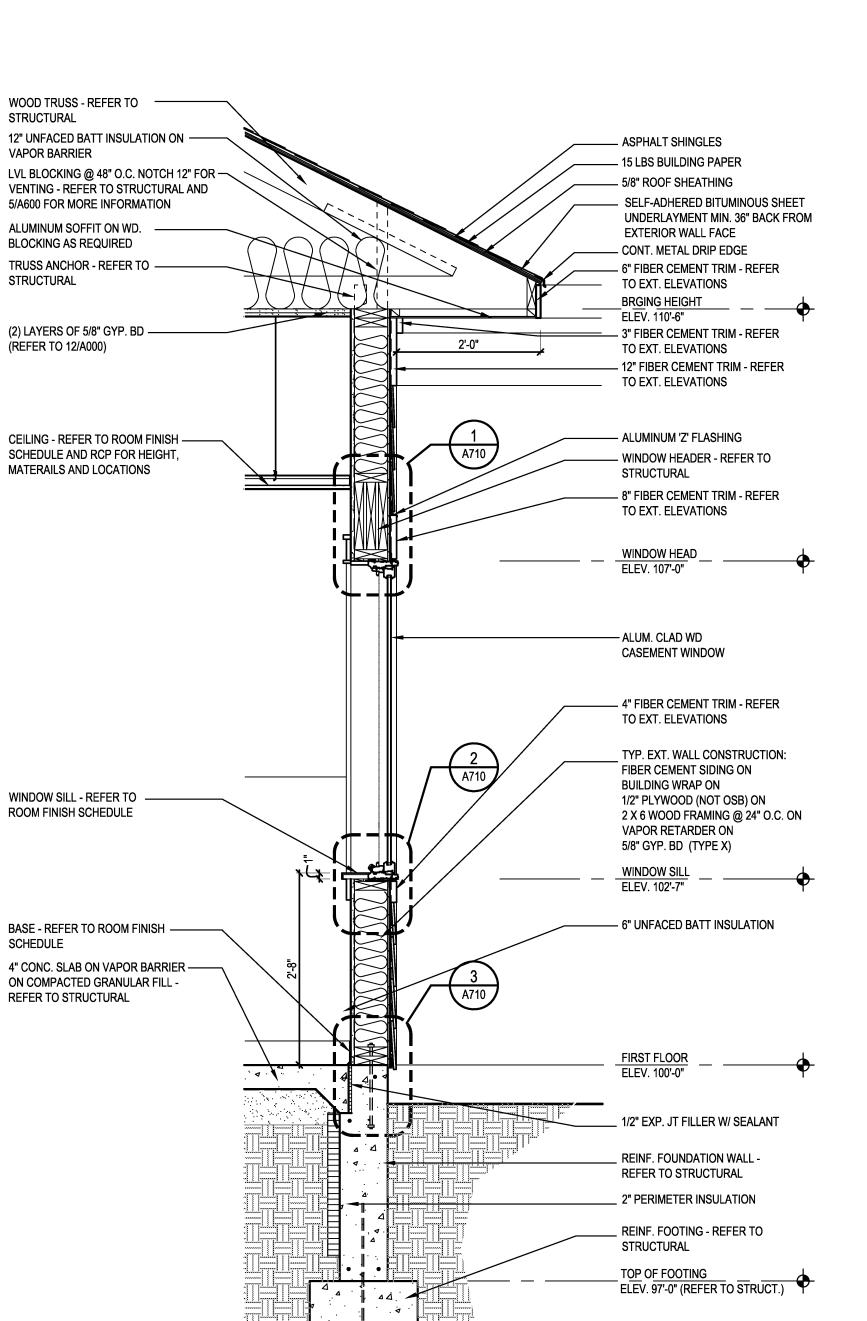

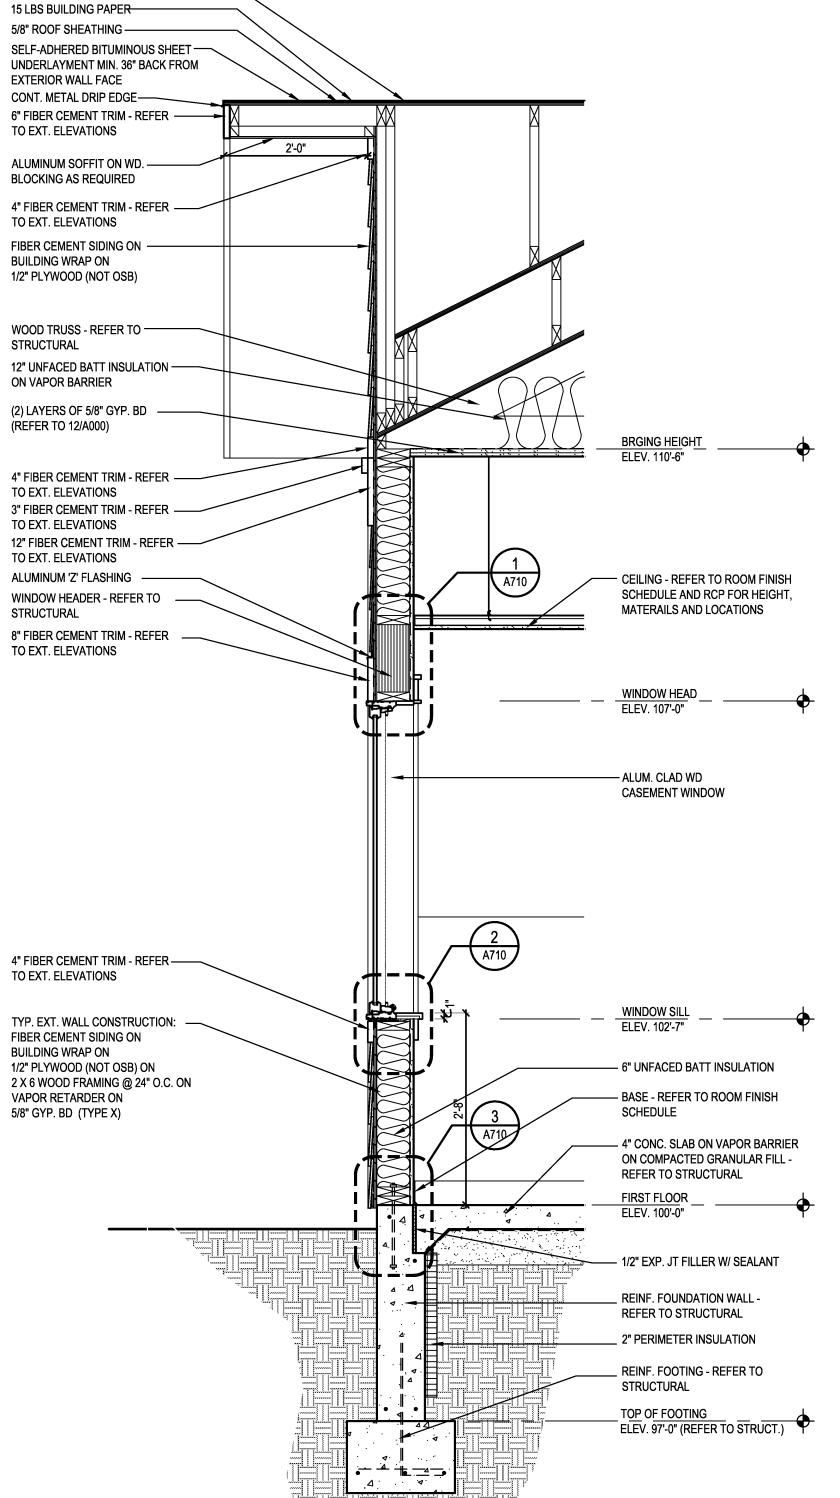

ASPHALT SHINGLES -

• • • •

• • • •

. . . .

• • • •

• • • •

. . . .

• • • • • • • •

02/21/12 ISSUED FOR BIDS

.

.

.