

ADDENDUM NO. 1

| | |
|--------------------------------|---|
| <i>DATE OF ISSUANCE</i> | April 23, 2012 |
| <i>PROJECT</i> | Louis E. Legg Middle School 175 Green Street Coldwater, Michigan 49036 |
| <i>OWNER</i> | Coldwater Community Schools |
| <i>ARCHITECT'S PROJECT NO.</i> | 11-165.30 |
| <i>BIDDING DOCUMENT DATE</i> | April 16, 2012 |

SCOPE OF WORK

This Addendum includes changes to, or clarifications of, the original Bidding Documents and any previously issued addenda, and shall be included in the Bid. All of these Addendum items form a part of the Contract Documents. The Bidder shall acknowledge receipt of this Addendum in the appropriate space provided on the Bid Form. Failure to do so may result in disqualification of the Bid.

DOCUMENTS INCLUDED IN THIS ADDENDUM

This Addendum includes three (3) pages of text and the following documents:

- Bidding Documents: BRFI Form, Owner's Asbestos Report, Pre bid Meeting Attendees
- Contract Conditions: None.
- Specification Sections: None.
- Sketches: A-1, A-2, A-3, A-4, A-5, A-6, A-7, A-8, A-9, and A-10.
- Drawings: None.

CHANGES TO PREVIOUSLY ISSUED ADDENDA

None.

CHANGES TO BIDDING REQUIREMENTS

ADD-1 Item No. B-1 - BRFI Form

See attached BRFI form.

CHANGES TO CONTRACT CONDITIONS

None.

CHANGES TO SPECIFICATIONS

ADD-1 Item No. S-1 - Door Hardware Set: 15.0

Refer to Specification Section 08 7100, subsection 3.6, paragraph B. Add Set: 15.0 as follows:

Set: 15.0

| | | | |
|--------------------|----------------------------|-----|----|
| 1 Continuous Hinge | CFMSLF-HD1 | | PE |
| 1 Entry Lock | L9456 x 17B | 626 | SC |
| 1 Mortise Cylinder | BY ENRICO GROUP | 626 | |
| 1 Closer | 4111 SHCUC | AL | LC |
| 1 Weatherseal | BY ALUMINIUM DOOR SUPPLIER | | |
| 1 Threshold | 171A | | PE |
| 1 Sweep | 3452CV | | PE |

CHANGES TO DRAWINGS

ADD-1 Item No. D-1 - Additional Door Demolition

Refer to Drawing AD 101A (not reissued) and attached sketch A-1. Revised door near column line AF/A11 to match existing configuration and location. Added door near column line AF/A10.

Refer to Drawing AD 101E (not reissued) and attached sketch A-2. Added doors at room E104 as indicated.

Refer to Drawing AD 301 (not reissued) and attached sketch A-3. Revised detail C/AD301 Unit A West Elevation as indicated.

ADD-1 Item No. D-2 - Door Revisions

Refer to Drawing A 101A (not reissued) and attached sketch A-4. Revise door A119 as indicated. Add door A122A as indicated.

Refer to Drawing A 101B (not reissued) and attached sketches A-5, A-6, and A-7. Omit door and frames for door B102B, C102B, and D102B.

Refer to Drawing A 101E (not reissued) and attached sketch A-8. Add doors E104A and E104B.

Refer to Drawing A 301 (not reissued) and attached sketch A-9. Revise detail C/A301 Unit A West Elevation as indicated.

ADD-1 Item No. D-3 - Door Schedule Revisions

Refer to Drawing A 501 (not reissued) and attached sketch A-10. Revise Door Schedule as indicated. Revise door A119 as indicated. Add door A122A. Omit door B 102B. Omit door C 102B. Omit door D 102B. Add door E104A. Add E104B. Revise frame elevation F3, horizontal dimension to read SEE PLAN in lieu of 7'-0".

END OF ADDENDUM

BRFI FORM

| | | | |
|-----------------------|--|------------------------|------------------------------------|
| To: | Shawn Parshall | Project Number: | 11-165.30 |
| | Project Manager | Project: | Coldwater Community Schools |
| | sparshall@towerpinkster.com | | Louis E. Legg Middle School |
| | TowerPinkster | BRFI #: | _____ |
| | 242 E. Kalamazoo Avenue | Date: | _____ |
| | Suite 200 | | |
| | Kalamazoo, MI 49007 | RFI Subject: | _____ |
| | Phone: 269.343.6133 | | |
| | Fax: 269.343.6633 | | |
| From: | _____ | | |
| Subcontractor: | _____ | Spec Section: | _____ |
| Phone: | _____ | Drwg(s): | _____ |
| Fax: | _____ | Detail #: | _____ |
| E-Mail: | _____ | Cost Impact: | _____ |
| Bid Package #: | _____ | Time Impact: | _____ |

Request:

Possible Solution:

Response:

Answered by:

Date:

Three Year Reinspection for Coldwater Community School

Legg Middle School

Materials removed since last inspection: 350 sq ft of floor tile from kitchen was non friable, assumed ACM.

Item #

THERMAL SYSTEM INSULATION

Area #1 - 1966

1. **FLUE WRAP:** 400 sq ft, Non friable, ACM, located in the boiler room above the boilers.

MISCELLANEOUS MATERIALS

2. **BLACK LAB:** 325 sq ft, Non friable, Assumed ACM, located in the following rooms: room 305, 205, 105,
3. **FLOOR TILE:** 15,150 sq ft, Non friable, Assumed ACM, located throughout the building.

**ALL FIRE DOORS, THERMAL GASKETS, FIRE BRICKS,
ARE ASSUMED TO BE ACM NON FRIABLE, UNLESS OTHERWISE STATED.**

COLDWATER COMMUNITY SCHOOLS ACM SUMMARY

Page 4 of 11

LEGG MIDDLE SCHOOL

THERMAL SYSTEM INSULATION

AREA 1 - 1966 Original Building

A. ACM NF Flue Wrap in BR, 400 sq ft in GC.

SURFACING MATERIALS

No surfacing ACBM found.

MISCELLANEOUS MATERIALS

AREA 1 - 1966 Original Building

A. There is 150 sq ft of AS Black Lab in RM305, 175 sq ft in RM205. RM105 has 40 sq ft of Black Lab.

B. AS ACM NF FT, There is approx. 15,400 sq ft of FT in the middle school. All Floor Tile present in building is AS ACM NF.

ALL FIRE DOORS**FIRE BRICKS**THERMAL SYSTEM GASKETS
ARE ASSUMED ACM UNLESS OTHER WISE STATED

Management Plan Recommendations for Coldwater Community Schools
Page 7 of 20

Legg Middle School - Page 1 of 1

THERMAL SYSTEM INSULATION

Area 1 - 1966 Original Building

AGREE DISAGREE

- (✓) () 1. The insulation (400 SQ. ft.) on the flue in the boiler room is ACM. Nonfriable. We recommend O & M.

SURFACING MATERIALS

No surfacing ACM found.

MISCELLANEOUS MATERIALS

Area 1 - 1966 Original Building


- (✓) () 2. There is a total of about 265 sq. ft. of black laboratory table/counter top material in rooms 305, 205, & 105. Nonfriable. We recommend O & M. (Not covered by AHERA.)
- (✓) () 3. The floor tiles (15,400 sq. ft.) are assumed to be ACM and are nonfriable. These tiles are not to be damaged, drilled, sanded, ground, or handled in any way which will disturb material so as to release fibers. O & M recommended.

GENERAL BUILDING STATEMENTS

- (✓) () 4. The insulation in fire doors throughout this building is Assumed to be ACM. These doors are not to be sanded, drilled, or handled in anyway which will disturb material so as to release fibers. O & M Recommended.
- (✓) () 5. Thermal Gaskets and fire bricks are assumed to be ACM unless otherwise noted in the report. These materials are nonfriable and are not to be disturbed in any way which will release fibers. We recommend O & M.


Additional Comments: There may be ACM located behind barriers that we do not know about. It is our recommendation that your APM or the Designated Person be on hand when major demolition occurs.

I, as the Designated Person, have read the recommendations, considered that the LEA has the financial resources needed to accomplish the recommendations (includes reinspection and training (form 93H)), checked the appropriate boxes, and responded accordingly as per your opening paragraph.


Eugene Wallace
(Designated Person)

1-6-89

date


Randall D. Smyth Cert: MAIC #00687
(Management Planner)

COLDWATER COMMUNITY SCHOOLS INSPECTION REPORT
Page 6 of 18

LEGG MIDDLE SCHOOL

THERMAL SYSTEM INSULATION

AREA 1 - 1966 Original Building

- A. SUS ACM Non Friable Holding Tank Wrap in BR, 350 sq ft in GC. Samples CLES-1-1,2,3
- B. SUS ACM Non Friable Mixing Tank Wrap in BR, 175 sq ft in GC. CLES-1-4,5,6
- C. SUS ACM Non Friable Flue Wrap in BR, 400 sq ft in GC. Samples CLES-1-7,8,9
- D. SUS ACM Non Friable ELS on FGPW, 54 ELS in Boiler Room. Samples CLES-1-10,11,12
 - * SE bottom of holding tank, EL is Damaged and Friable.
 - * NE bottom of holding tank, EL is Damaged and Friable.
 - * EL Damaged where duct tape is at in middle of RM.
 - * EL Damaged and Friable of boiler on NW end.
 - Phys. ED RM S Power RM has 8 ELS, N Power RM has 15 ELS
 - * EL Damaged and Friable next to valve.
 - Blower RM in Boys locker room has 16 ELS, GLR has 8 ELS.
 - RM424 12 ELS, Storeroom off Kitchen has 4 ELS.
- E. SUS ACM Non Friable ELS on FGPW Catwalk RMS 1st RM Left 8 ELS, 2nd RM L 6 ELS. Samples CLES-1-21,22,23.
 - * 12' Right of Door Damaged EL with debris on floor.
 - * 10' Left from door, Damaged and friable.
 - * 20' Left from door, Damaged and friable with debris on Floor
 - 1st R Room 10 ELS, 2nd R Room 10 ELS
 - * Left of door 10' Damaged and Friable.
 - Catwalk near Kitchen Side, 2nd RM L 14 ELS, 3rd RM L 13 ELS
 - * Left of door debris near EL that was fixed.
 - 1st R RM 15 ELS
 - * Left from door 10' debris on floor.
 - 2nd R RM, 9 ELS, 3rd R RM 2 ELS.

SURFACING MATERIALS

AREA 1 - 1966 Original Building

- A. SUS ACM NF Drywall Compound RM432,423 has 600 sq ft. RM424 1,100 sq ft, RM425 640 sq ft, RM426 1,400 sq ft, Offices 4,800 sq ft, RM409 1,300 sq ft, RMS 300-303, 304, 306-308 each have 960 sq ft, RM305 has 1,720. RMS 410-412 each have 940 sq ft, RMS 200, 202, 203, 207, 208, each have 800 sq ft. RM 204 has 600 sq ft, RMS 206 and RM 205 have 1,000 sq ft, RM413 has 1,350 sq ft, RM414 has 1,800 sq ft, RM101, 104, 107, each have 900 sq ft, RM105, 416, 106, each have 1000 sq ft, RM100, 102 each have 800 sq ft, and RM415 has 1,700 sq ft. Storage RMS next to RM415 has 1,200 sq ft. Kitchen Office has 600 sq ft. Stage 2,200 sq ft, Entrances to Stage 600 sq ft, Media Center 2,450 sq ft. Samples CLES-1-13,17,20.
- B. SUS ACM NF Text. Plaster, NW Storage in Phys. ED RM. 175 sq ft. Lockerrooms 6,175 sq ft, RM305 has 360 sq ft. Samples CLES-1-15.

COLDWATER COMMUNITY SCHOOLS INSPECTION REPORT
Page 7 of 18

Legg Middle School - continued

Surfacing Material - continued

- C. SUS ACM Non Friable Plaster, The Janitors RM, the Girls and Boys Bathroom next to RM301 each have 120 sq ft. The faculties Men and Ladies Bathroom each have 96 sq ft, the janitors storage has 100 sq ft. The girls and Boys bathrooms next to RM201 each have 120 sq ft, and the janitors storage has 80 sq ft. The boys and girls Bathrooms next to RM414 each have 120 sq ft, and the janitors has 80 sq ft. Rear entry storage to Kitchen has 60 sq ft and the Bathroom in Kitchen has 90 sq ft, Stage has 3,000 sq ft, Media Center 2,400 sq ft. Samples CLES-1-18

MISCELLANEOUS MATERIALS

AREA 1 - 1966 Original Building

- A. SUS ACM Friable 2'x 4' CT, NW entry to GYM has 64 sq ft. Offices 1,840 sq ft, Storeroom off kitchen 560 sq ft stored on floor. CLES-1-14
- B. SUS ACM Non Friable Acoustical CT, RM424 (Band RM) 84 sq ft, RM425 (Music RM) 60 sq ft. CLES-1-16
- C. SUS ACM Friable 12"x 12" CT in Cafeteria 2,700 sq ft. Sample CLES-1-19
- D. AS ACM Non Friable Floor Tile, There is approx. 15,400 sq ft of FT in the middle school. All Floor Tile present in building is AS ACM Non Friable. To note location, look at FLOOR TILE INFORMATION SHEET.
- E. There is 150 sq ft of Assumed ACM Black Lab in RM305, 175 sq ft in RM205. RM105 has 40 sq ft of Black Lab.
- F. Suspect ACM NF Drywall - RM432,423 has 600 sq ft. RM424 1,100 sq ft, RM425 640 sq ft, RM426 1,400 sq ft, Offices 4,800 sq ft, RM409 1,300 sq ft, RMS 300-303, 304, 306-308 each have 960 sq ft, RM305 has 1,720. RMS 410-412 each have 940 sq ft, RMS 200, 202, 203, 207, 208, each have 800 sq ft. RM 204 has 600 sq ft, RMS 206 and RM 205 have 1,000 sq ft, RM413 has 1,350 sq ft, RM414 has 1,800 sq ft, RM101, 104, 107, each have 900 sq ft, RM105, 416, 106, each have 1000 sq ft, RM100, 102 each have 800 sq ft, and RM415 has 1,700 sq ft. Storage RMS next to RM415 has 1,200 sq ft. Kitchen Office has 600 sq ft. Stage 2,200 sq ft, Entrances to Stage 600 sq ft, Media Center 2,450 sq ft. Samples CLES 1-24, 1-25, & 1-26.

ALL FIRE DOORS, THERMAL SYSTEM GASKETS AND FIRE BRICKS ARE ASSUMED TO BE
ACM AND ARE NONFRIABLE UNLESS OTHERWISE STATED.

Legg Middle School - Page 1 of 1

THERMAL SYSTEM INSULATION

Area 1 - 1966 Original Building

AGREE DISAGREE

- (✓) () 1. The insulation (400 SQ. ft.) on the flue in the boiler room is ACM. Nonfriable. We recommend O & M.

SURFACING MATERIALS

No surfacing ACBM found.

MISCELLANEOUS MATERIALS

Area 1 - 1966 Original Building

- (✓) () 2. There is a total of about 265 sq. ft. of black laboratory table/counter top material in rooms 305, 205, & 105. Nonfriable. We recommend O & M. (Not covered by AHERA.)
- (✓) () 3. The floor tiles (15,400 sq. ft.) are assumed to be ACM and are nonfriable. These tiles are not to be damaged, drilled, sanded, ground, or handled in any way which will disturb material so as to release fibers. O & M recommended.

GENERAL BUILDING STATEMENTS

- (✓) () 4. The insulation in fire doors throughout this building is Assumed to be ACM. These doors are not to be sanded, drilled, or handled in anyway which will disturb material so as to release fibers. O & M Recommended.
- (✓) () 5. Thermal Gaskets and fire bricks are assumed to be ACM unless otherwise noted in the report. These materials are nonfriable and are not to be disturbed in any way which will release fibers. We recommend O & M.

Additional Comments: There may be ACM located behind barriers that we do not know about. It is our recommendation that your APM or the Designated Person be on hand when major demolition occurs.

I, as the Designated Person, have read the recommendations, considered that the LEA has the financial resources needed to accomplish the recommendations (includes reinspection and training (form 93H)), checked the appropriate boxes, and responded accordingly as per your opening paragraph.

Eugene F. Wallace
Eugene Wallace
(Designated Person)

1-6-89

date

Randall D. Smyth 1/3/89
Randall D. Smyth Cert: MAIC #00687
(Management Planner)

Dorothy Legg Middle School

Item #

THERMAL SYSTEM INSULATION

Area #1 - 1966

1. **FLUE WRAP:** 400 sq ft, Non friable, ACM, located in the boiler room above the boilers.

MISCELLANEOUS MATERIALS

2. **BLACK LAB:** 325 sq ft, Non friable, Assumed ACM, located in the following rooms: room 305, 205, 105,
3. **FLOOR TILE:** 15,400 sq ft, Non friable, Assumed ACM, located throughout the building.

**ALL FIRE DOORS, THERMAL GASKETS, FIRE BRICKS,
ARE ASSUMED TO BE ACM NON FRIABLE, UNLESS OTHERWISE STATED.**

COLDWATER COMMUNITY SCHOOLS INSPECTION REPORT
Page 6 of 16

LEGG MIDDLE SCHOOL

THERMAL SYSTEM INSULATION

AREA 1 - 1966 Original Building

- A. SUS ACM Non Friable Holding Tank Wrap in BR, 350 sq ft in GC. Samples CLES-1-1,2,3
- B. SUS ACM Non Friable Mixing Tank Wrap in BR, 175 sq ft in GC. CLES-1-4,5,6
- C. SUS ACM Non Friable Flue Wrap in BR, 400 sq ft in GC. Samples CLES-1-7,8,9
- D. SUS ACM Non Friable ELS on FGPW, 54 ELS in Boiler Room. Samples CLES-1-10,11,12
 - * SE bottom of holding tank, EL is Damaged and Friable.
 - * NE bottom of holding tank, EL is Damaged and Friable.
 - * EL Damaged where duct tape is at in middle of RM.
 - * EL Damaged and Friable of boiler on NW end.
 - Phys. ED RM S Power RM has 8 ELS, N Power RM has 15 ELS
 - * EL Damaged and Friable next to valve.
 - Blower RM in Boys locker room has 16 ELS, GLR has 8 ELS.
 - RM424 12 ELS, Storeroom off Kitchen has 4 ELS.
- E. SUS ACM Non Friable ELS on FGPW Catwalk RMS 1st RM Left 8 ELS, 2nd RM L 6 ELS. Samples CLES-1-21,22,23.
 - * 12' Right of Door Damaged EL with debris on floor.
 - * 10' Left from door, Damaged and friable.
 - * 20' Left from door, Damaged and friable with debris on Floor
 - 1st R Room 10 ELS, 2nd R Room 10 ELS
 - * Left of door 10' Damaged and Friable.
 - Catwalk near Kitchen Side, 2nd RM L 14 ELS, 3rd RM L 13 ELS
 - * Left of door debris near EL that was fixed.
 - 1st R RM 15 ELS
 - * Left from door 10' debris on floor.
 - 2nd R RM, 9 ELS, 3rd R RM 2 ELS.

SURFACING MATERIALS

AREA 1 - 1966 Original Building

- A. SUS ACM NF Drywall Compound RM432,423 has 600 sq ft. RM424 1,100 sq ft, RM425 640 sq ft, RM426 1,400 sq ft, Offices 4,800 sq ft, RM409 1,300 sq ft, RMS 300-303, 304, 306-308 each have 960 sq ft, RM305 has 1,720. RMS 410-412 each have 940 sq ft, RMS 200, 202, 203, 207, 208, each have 800 sq ft. RM 204 has 600 sq ft, RMS 206 and RM 205 have 1,000 sq ft, RM413 has 1,350 sq ft, RM414 has 1,800 sq ft, RM101, 104, 107, each have 900 sq ft, RM105, 416, 106, each have 1000 sq ft, RM100, 102 each have 800 sq ft, and RM415 has 1,700 sq ft. Storage RMS next to RM415 has 1,200 sq ft. Kitchen Office has 600 sq ft. Stage 2,200 sq ft, Entrances to Stage 600 sq ft, Media Center 2,450 sq ft. Samples CLES-1-13,17,20.
- B. SUS ACM NF Text. Plaster, NW Storage in Phys. ED RM. 175 sq ft. Lockerrooms 6,175 sq ft, RM305 has 360 sq ft. Samples CLES-1-15.

COLDWATER COMMUNITY SCHOOLS INSPECTION REPORT
Page 7 of 16

Legg Middle School - continued

Surfacing Material - continued

- C. SUS ACM Non Friable Plaster, The Janitors RM, the Girls and Boys Bathroom next to RM301 each have 120 sq ft. The faculties Men and Ladies Bathroom each have 96 sq ft, the janitors storage has 100 sq ft. The girls and Boys bathrooms next to RM201 each have 120 sq ft, and the janitors storage has 80 sq ft. The boys and girls Bathrooms next to RM414 each have 120 sq ft, and the janitors has 80 sq ft. Rear entry storage to Kitchen has 60 sq ft and the Bathroom in Kitchen has 90 sq ft, Stage has 3,000 sq ft, Media Center 2,400 sq ft. Samples CLES-1-18

MISCELLANEOUS MATERIALS

AREA 1 - 1966 Original Building

- A. SUS ACM Friable 2'x 4' CT, NW entry to GYM has 64 sq ft. Offices 1,840 sq ft, Storeroom off kitchen 560 sq ft stored on floor. CLES-1-14
- B. SUS ACM Non Friable Acoustical CT, RM424 (Band RM) 84 sq ft, RM425 (Music RM) 60 sq ft. CLES-1-16
- C. SUS ACM Friable 12"x 12" CT in Cafeteria 2,700 sq ft. Sample CLES-1-19
- D. AS ACM Non Friable Floor Tile, There is approx. 15,400 sq ft of FT in the middle school. All Floor Tile present in building is AS ACM Non Friable. To note location, look at FLOOR TILE INFORMATION SHEET.
- E. There is 150 sq ft of Assumed ACM Black Lab in RM305, 175 sq ft in RM205. RM105 has 40 sq ft of Black Lab.

ALL FIRE DOORS, THERMAL SYSTEM GASKETS AND FIRE BRICKS ARE ASSUMED TO BE ACM AND ARE NONFRIABLE UNLESS OTHERWISE STATED.

BULK SAMPLING REQUEST FORM

SENT TO:
Industrial Environmental Consultants
1350 East Lake Lansing Rd.
East Lansing, MI 48823
(517) 351-4002

FROM: Trust Thermal Systems
629 E. Sheridan Rd.
Lansing, MI 48906
(517) 484 - 1125
Homogeneous area (see maps)

School District:

Area 1 = 1966

Coldwater Community Schools
Legg Middle School
175 Green Street.
Coldwater, MI. 49036

Code: (* = sample sent) (o = not sent) (+ = sent later)
(Cr = Crocidolite) (A = Amosite) (C = Chrysotile) (ND = None Detected)

Submitted by: Gary Van Sickle

Signature Gary Van Sickle

| Result | Sample ID | | Area | mm/dd/yy | Location |
|--------|-----------|---|------|----------|--|
| ND | CLES 1-1 | * | 1 | 5/17/88 | Holding Tank Wrap-N end. |
| ND | CLES 1-2 | + | 1 | 5/31/88 | " " " -NE end. |
| ND | CLES 1-3 | + | 1 | " " " | " " " -NW end. |
| ND | CLES 1-4 | * | 1 | 5/17/88 | Mixing Tank Wrap-BR |
| ND | CLES 1-5 | + | 1 | 5/31/88 | " " " -BR |
| ND | CLES 1-6 | + | 1 | " " " | " " " -BR |
| 85% C | CLES 1-7 | * | 1 | 5/17/88 | Flue Wrap-S of Boiler. |
| | CLES 1-8 | o | 1 | | " " -between Boilers. |
| | CLES 1-9 | o | 1 | | " " -N of Boiler. |
| ND | CLES 1-10 | * | 1 | 5/17/88 | ELBOW-BR |
| ND | CLES 1-11 | + | 1 | 5/31/88 | " " " |
| ND | CLES 1-12 | + | 1 | " " " | " " " |
| ND | CLES 1-13 | * | 1 | 5/17/88 | Drywall Compound-Artroom entry from BR side. |
| ND | CLES 1-14 | * | 1 | " " " | 2'x 4' CT-NW entrance GYM. |
| ND | CLES 1-15 | * | 1 | " " " | Text. Plaster-NW Storage Phys. ED RM. |
| ND | CLES 1-16 | * | 1 | " " " | Acoustical CT-Band RM. |
| ND | CLES 1-17 | * | 1 | " " " | Drywall Compound-Office Health RM. |
| ND | CLES 1-18 | * | 1 | " " " | Plaster-Boys Bathroom next to RM301. |
| ND | CLES 1-19 | * | 1 | " " " | 12"x 12" CT-Cafeteria. |
| ND | CLES 1-20 | * | 1 | " " " | Drywall Compound-off stage on Corner. |
| ND | CLES 1-21 | * | 1 | " " " | ELBOW-Catwalk 1st Door R, Kitchen side. |
| ND | CLES 1-22 | + | 1 | 5/31/88 | " " R 10' on catwalk, Kitchen side. |
| ND | CLES 1-23 | + | 1 | " " " | " " 2nd RM L on Kitchen side. |

POLARIZED LIGHT MICROSCOPY RESULTS
INDUSTRIAL ENVIRONMENTAL CONSULTANTS, LTD.

CLIENT: Trust Thermal Systems
 ATTENTION: Mr. Gary Van Sickle
 JOB SITE: Coldwater Schools

PA#: 8624
 DATE: June 6, 1988

| CLIENT ID | IEC LAB NO. | ASBESTOS TYPE | % | NON-ASBESTOS TYPE | % |
|---------------------------|-------------|------------------|----|-------------------------------------|----------------|
| <u>Legg Middle School</u> | | | | | |
| CLES 1-2 | 9456 | N.D. | <1 | Mineral Wool Mortar | 50 50 |
| CLES 1-3 | 9457 | N.D. | <1 | Mineral Wool Cellulose Mortar | 25 25 50 |
| CLES 1-5 | 9458 | N.D. | <1 | Cellulose Mineral Wool Mortar | 85 5 10 |
| CLES 1-6 | 9459 | N.D. | <1 | Mineral Wool Cellulose Mortar | 30 20 50 |
| CLES 1-11 | 9460 | N.D. | <1 | Mineral Wool Cellulose Mortar | 50 1 49 |
| CLES 1-12 | 9461 | N.D. | <1 | Mineral Wool Cellulose Mortar | 50 1 49 |
| CLES 1-22 | 9462 | N.D. | <1 | Mineral Wool Mortar | 50 50 |
| CLES 1-23 | 9463 | N.D. | <1 | Mineral Wool Cellulose Mortar | 50 2 48 |
| <u>Girard School</u> | | | | | |
| CGS 1-8 | 9464 | N.D. | <1 | Mineral Wool Cellulose Mortar | 30 30 40 |
| CGS 1-9 | 9465 | N.D. | <1 | Mineral Wool Cellulose Mortar | 30 30 40 |

| CLIENT ID | IEC LAB NO. | ASBESTOS TYPE | % | NON-ASBESTOS TYPE | % |
|---------------------------------------|-------------|------------------|----|--|----------------------|
| CHS 2-25 | 9095 | N.D. | <1 | Cellulose Mineral Wool Mortar Polystyrene | 50 30 10 10 |
| CHS 2-26 | 9096 | N.D. | <1 | Cellulose Mineral Wool Polystyrene | 50 40 10 |
| CHS 1-27 | 9097 | N.D. | <1 | Mortar | 100 |
| CHS 1-28 | 9098 | N.D. | <1 | Mortar | 100 |
| CHS 2-29 | 9099 | N.D. | <1 | Cellulose Mineral Wool Mortar | 40 20 40 |
| CHS 3-32 | 9100 | N.D. | <1 | Cellulose | 100 |
| CHS 3-33 | 9101 | N.D. | <1 | Cellulose Mineral Wool Mortar Polystyrene | 40 4 1 10 |
| CHS 3-34 | 9102 | N.D. | <1 | Cellulose | 100 |
| <u>Legg Middle School</u> CLES 1-1 | 9103 | N.D. | <1 | Mineral Wool Cellulose Mortar | 40 20 40 |
| CLES 1-4 | 9104 | N.D. | <1 | Mineral Wool Cellulose Mortar | 40 5 55 |
| CLES 1-7 | 9105 | Chrysotile | 85 | Cellulose Mortar | 10 5 |
| CLES 1-10 | 9106 | N.D. | <1 | Mineral Wool Cellulose Mortar | 40 1 59 |
| CLES 1-13 | 9107 | N.D. | <1 | Cellulose Mortar | 10 90 |
| CLES 1-14 | 9108 | N.D. | <1 | Cellulose Mineral Wool Polystyrene | 40 20 |

MEETING SIGN-IN SHEET


DATE: April 19, 2012

PROJECT: Coldwater Community Schools:
Louis E. Legg Middle School
Window and Door Replacement

PROJECT NO.: 11-165.30

MEETING PURPOSE: Mandatory Pre-Bid Walkthrough

| Name | Organization | Telephone | Fax | Email Address |
|--------------------|--------------------------------|--------------------|-----|---------------------------------------|
| 1. Bill Wiemer | Axiom CSG | 248.446.1104 | | estimating@axiomcsgllc.com |
| 2. Andy Patrick | B.C. Glass | 269.968.2791 | | andyp@battlecreekglass.com |
| 3. Chuck Walke | Trev. City Gl | 517.206.7178 | | |
| 4. Susan Mitoske | Home Depot | 517.279.1336 x 311 | | |
| 5. Andrew Harpster | At Home Services | 313.550.9478 | | andrew.harpster@THDathomeservices.com |
| 6. Pete Roon | AGM | 269.375.6165 | | proon@agm-michigan.com |
| 7. Bill Wolf | Wojan Window and Door | 517.278.2202 | | bill@wojan.com |
| 8. Shawn Parshall | TowerPinkster | 269.343.6133 | | sparshall@towerpinkster.com |
| 9. Brent McClure | TowerPinkster | 269.492.6759 | | bmcclure@towerpinkster.com |
| 10. Scott Lowder | Coldwater Community Schools | 517.279.5910 | | |

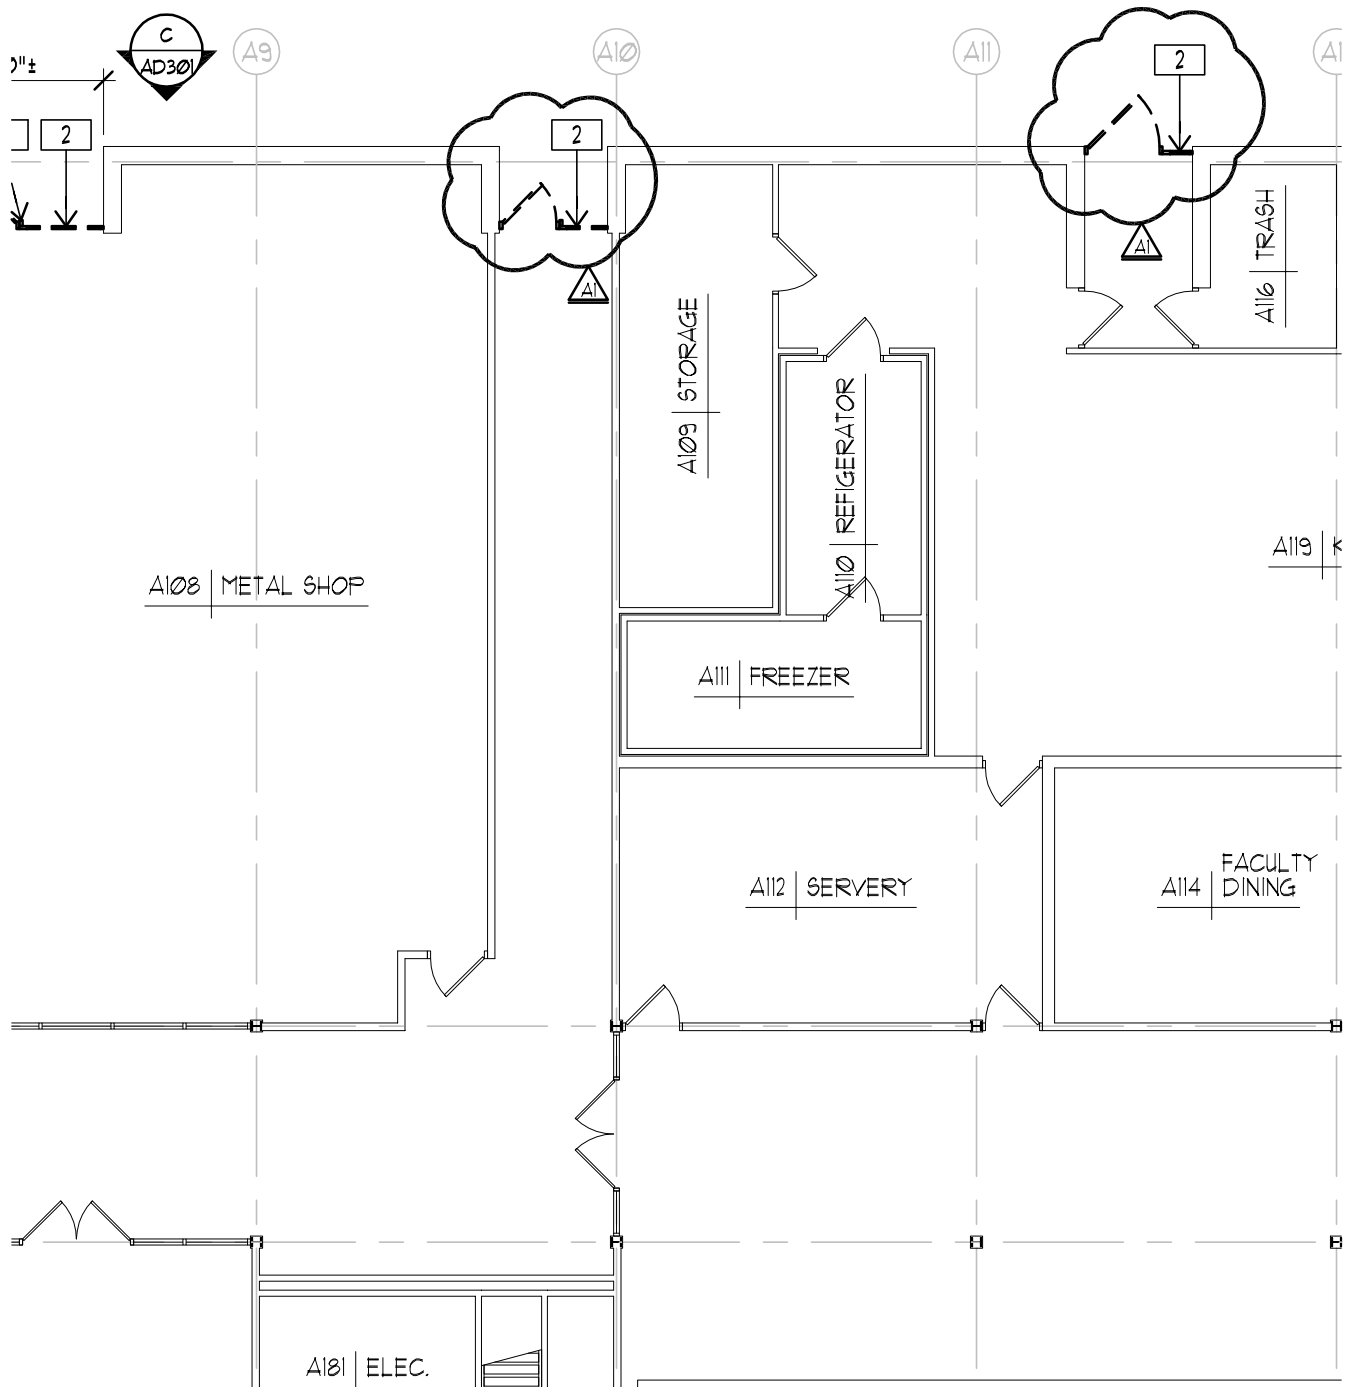

UNIT A DEMOLITION FLOOR PLAN

LOUIS E. LEGG MIDDLE SCHOOL
COLDWATER
COMMUNITY SCHOOLS

TowerPinkster
Making it real

© 2012 All rights reserved.


ADDENDUM NO.: 1

REFER TO DRAWING: AD 101A

A-1

APRIL 23, 2012

11-165.30

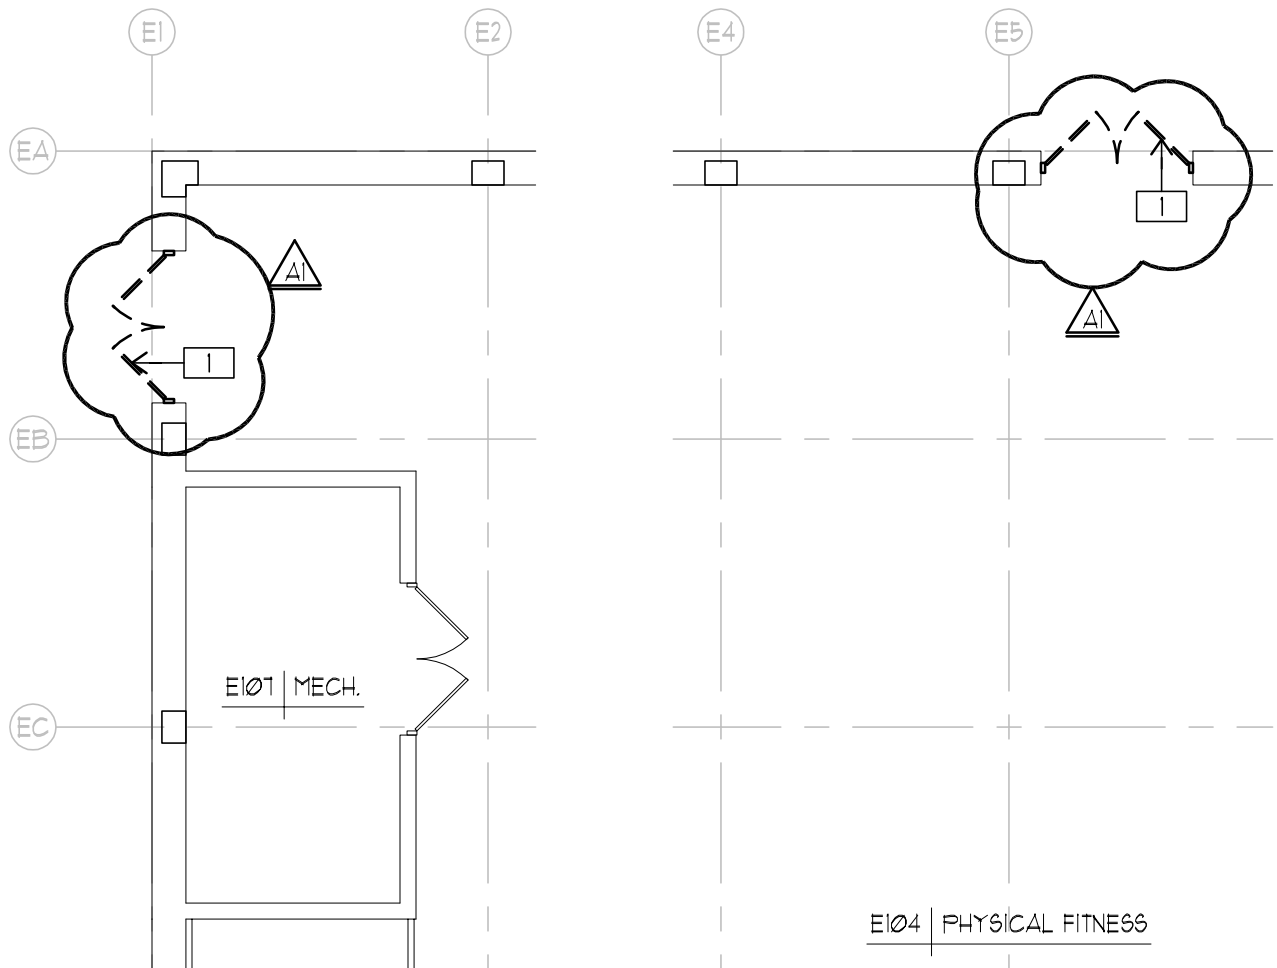

UNIT E DEMOLITION FLOOR PLAN

LOUIS E. LEGG MIDDLE SCHOOL
COLDWATER
COMMUNITY SCHOOLS

TowerPinkster
Making it real

© 2012 All rights reserved.



ADDENDUM NO.: 1

REFER TO DRAWING: AD 101E

A-2

APRIL 23, 2012

11-165.30

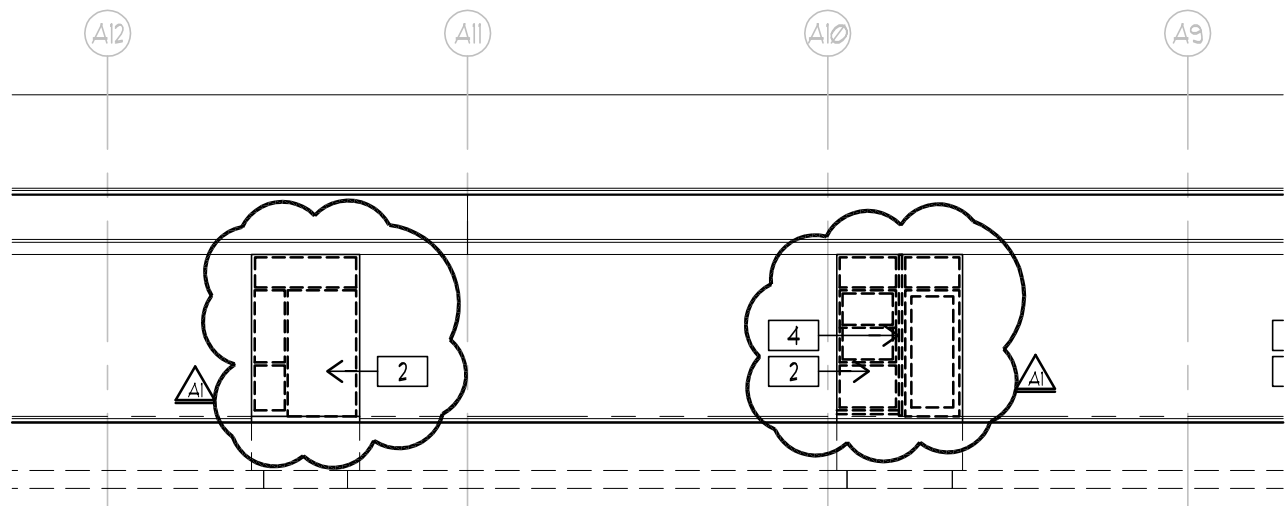

UNIT A WEST ELEVATION

SCALE: 3/32" = 1'-0"

EXTERIOR DEMOLITION ELEVATIONS

LOUIS E. LEGG MIDDLE SCHOOL
COLDWATER
COMMUNITY SCHOOLS

TowerPinkster
Making it real

© 2012 All rights reserved.


ADDENDUM NO.: 1

REFER TO DRAWING: AD 301

A-3

APRIL 23, 2012

11-165.30

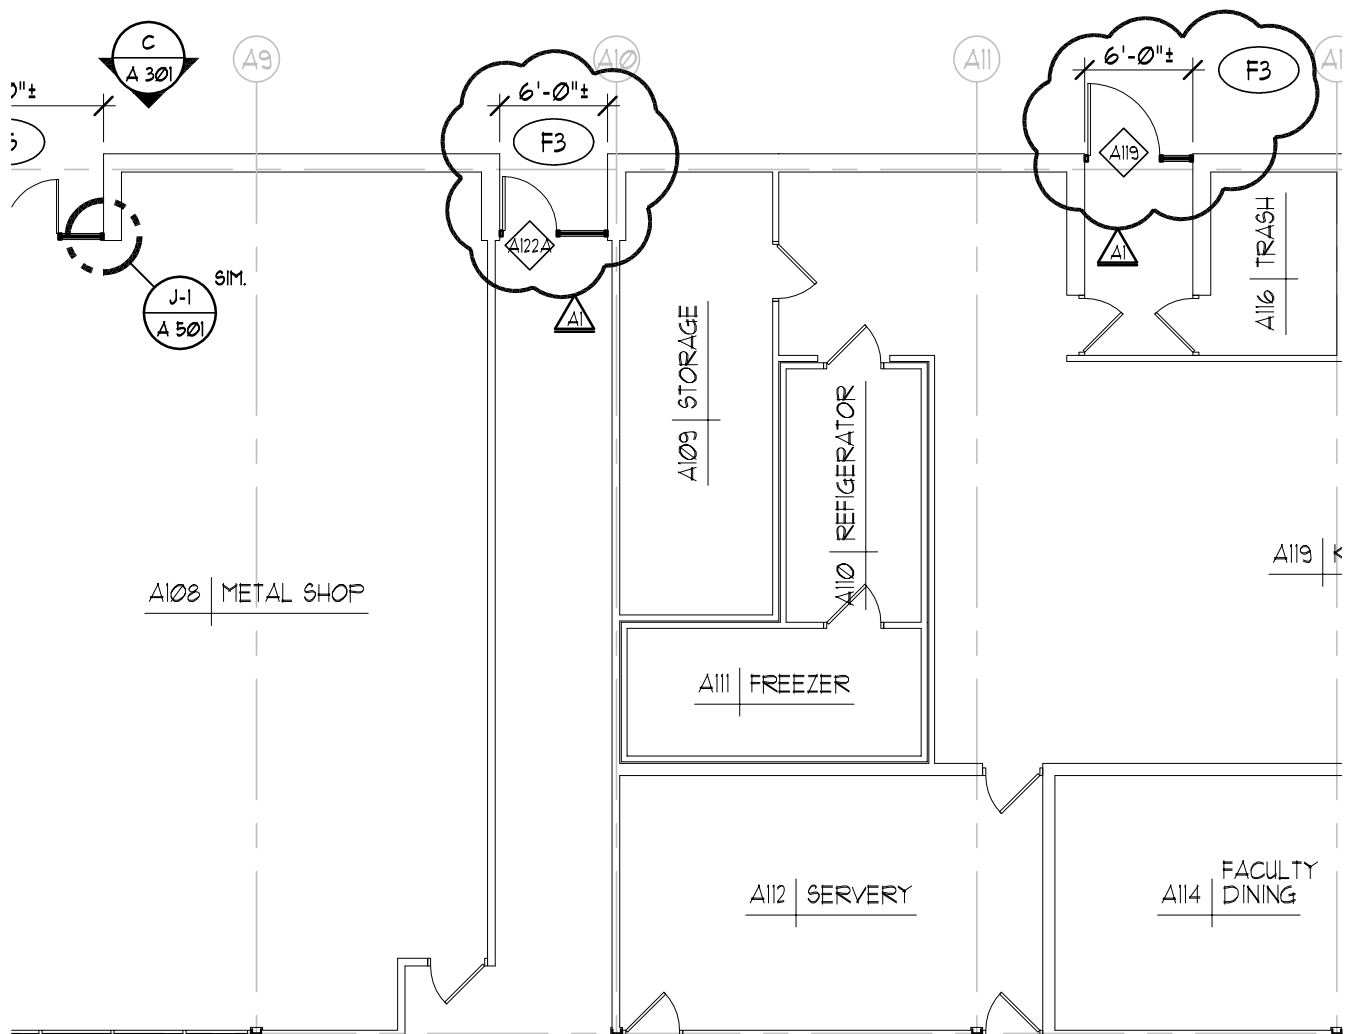

UNIT A FLOOR PLAN


LOUIS E. LEGG MIDDLE SCHOOL
COLDWATER
COMMUNITY SCHOOLS

TowerPinkster
Making it real

© 2012 All rights reserved.

ADDENDUM NO.: 1
REFER TO DRAWING: A 101A

A-4
APRIL 23, 2012
11-165.30

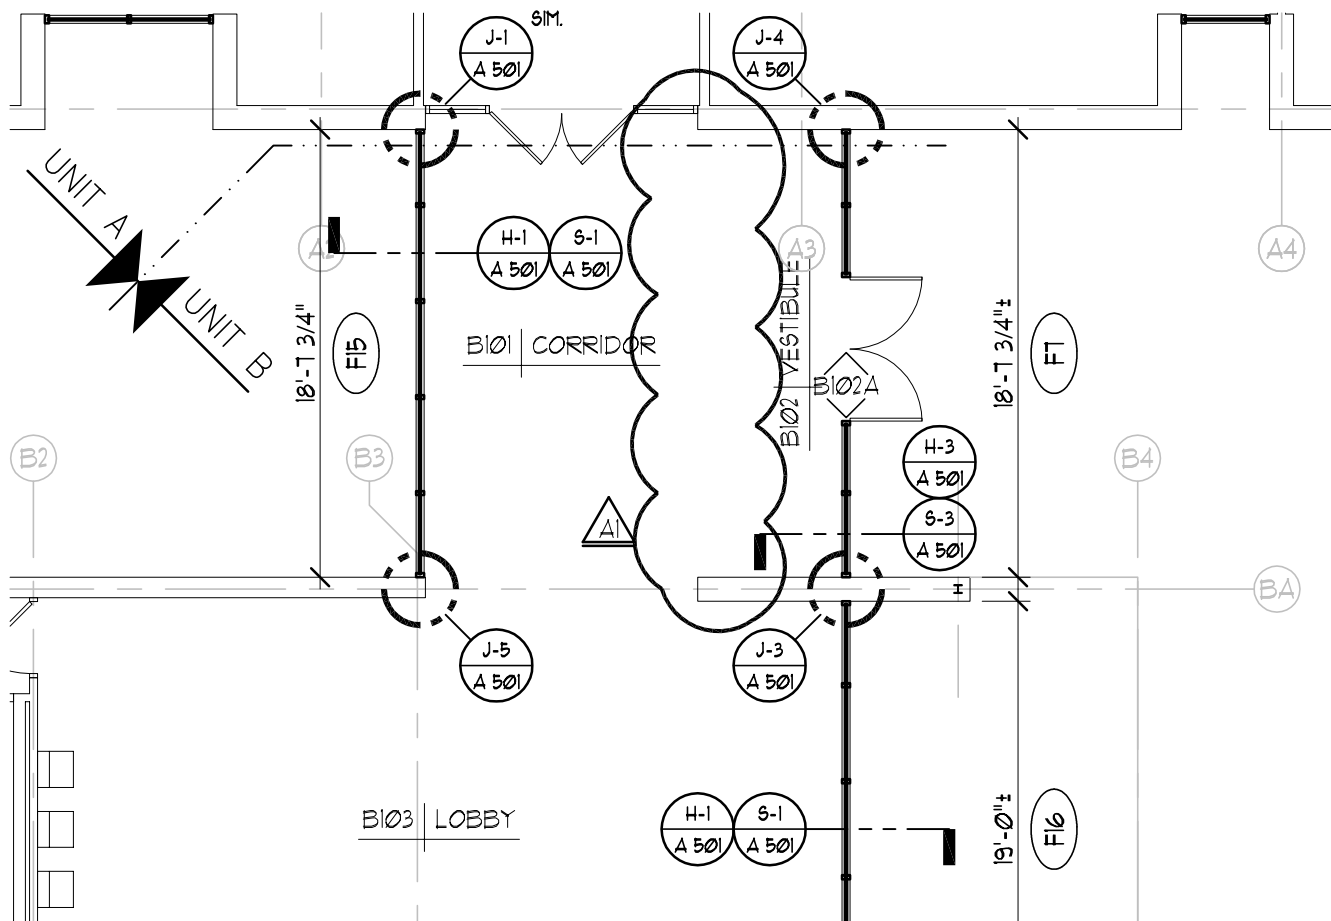

UNIT B FIRST FLOOR PLAN


LOUIS E. LEGG MIDDLE SCHOOL
COLDWATER
COMMUNITY SCHOOLS

TowerPinkster
Making it real

© 2012 All rights reserved.

ADDENDUM NO.: 1
REFER TO DRAWING: A 101B

A-5
APRIL 23, 2012
11-165.30

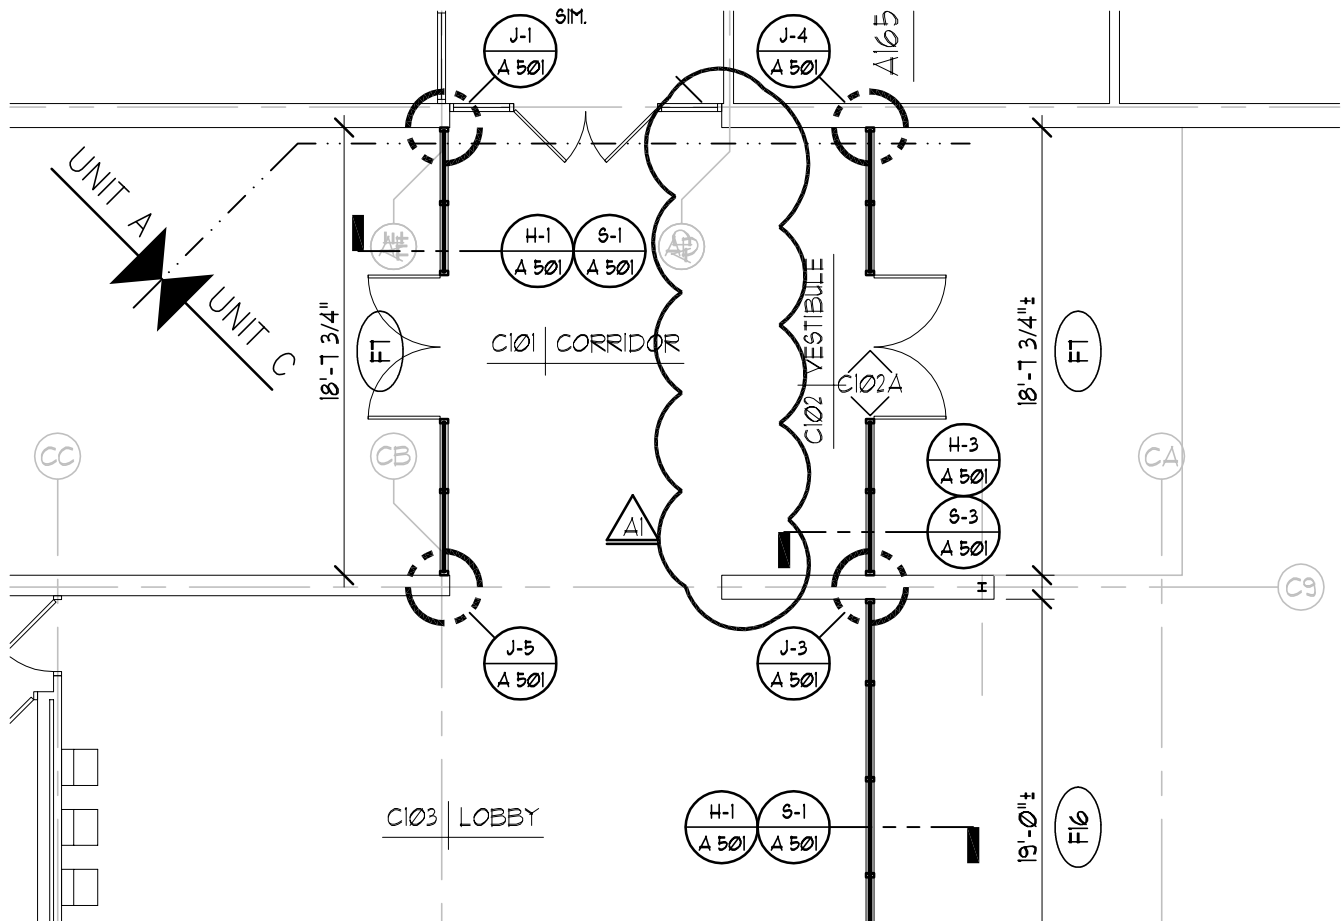


UNIT C FIRST FLOOR PLAN

LOUIS E. LEGG MIDDLE SCHOOL
COLDWATER
COMMUNITY SCHOOLS

TowerPinkster
Making it real

© 2012 All rights reserved.
ADDENDUM NO.: 1
REFER TO DRAWING: A 101B

A-6
APRIL 23, 2012
11-165.30

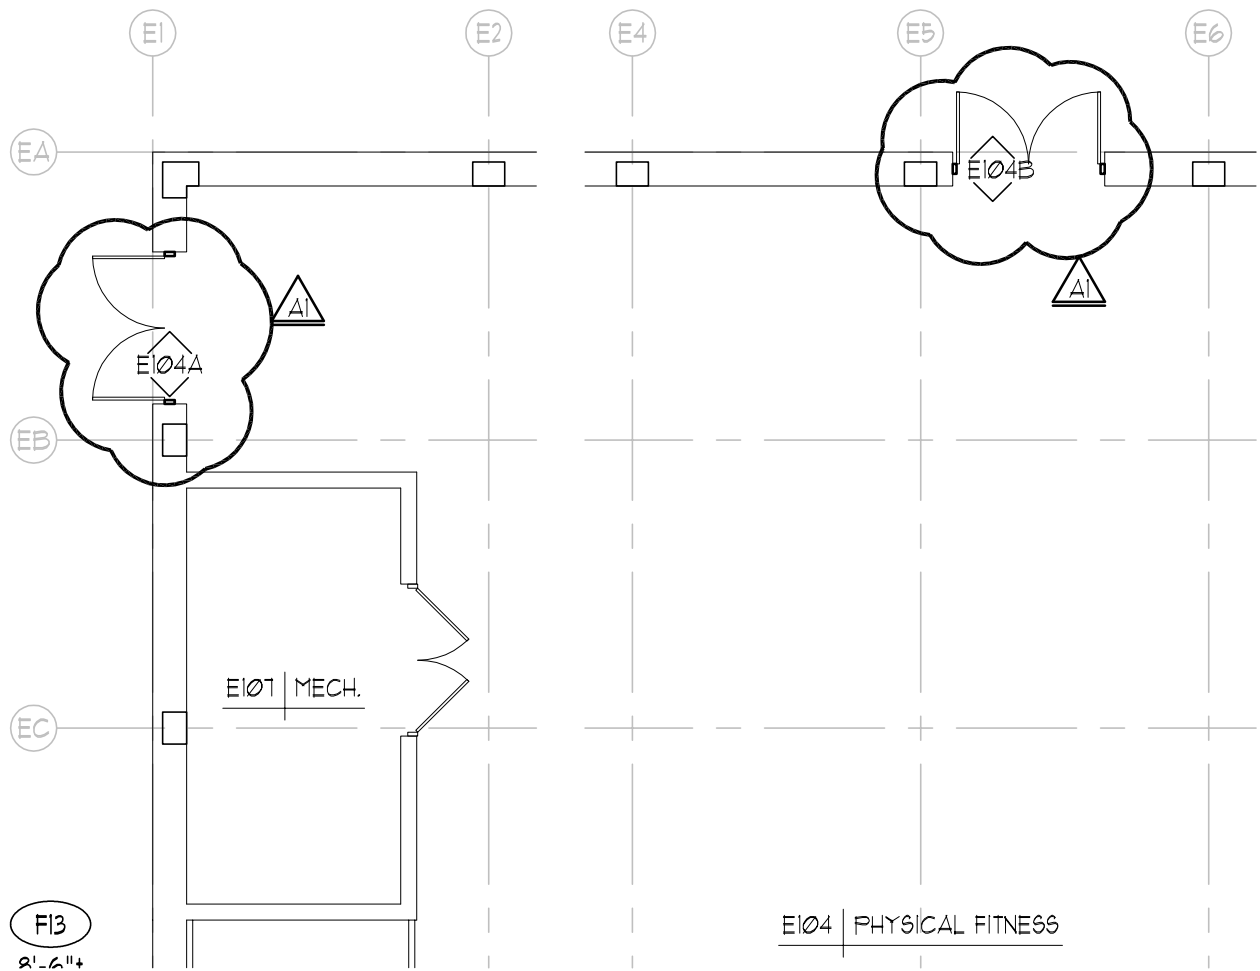

UNIT E FIRST FLOOR PLAN


LOUIS E. LEGG MIDDLE SCHOOL
COLDWATER
COMMUNITY SCHOOLS

TowerPinkster
Making it real


© 2012 All rights reserved.
ADDENDUM NO.: 1
REFER TO DRAWING: A 101E

A-8
APRIL 23, 2012
11-165.30

UNIT E  UNIT A

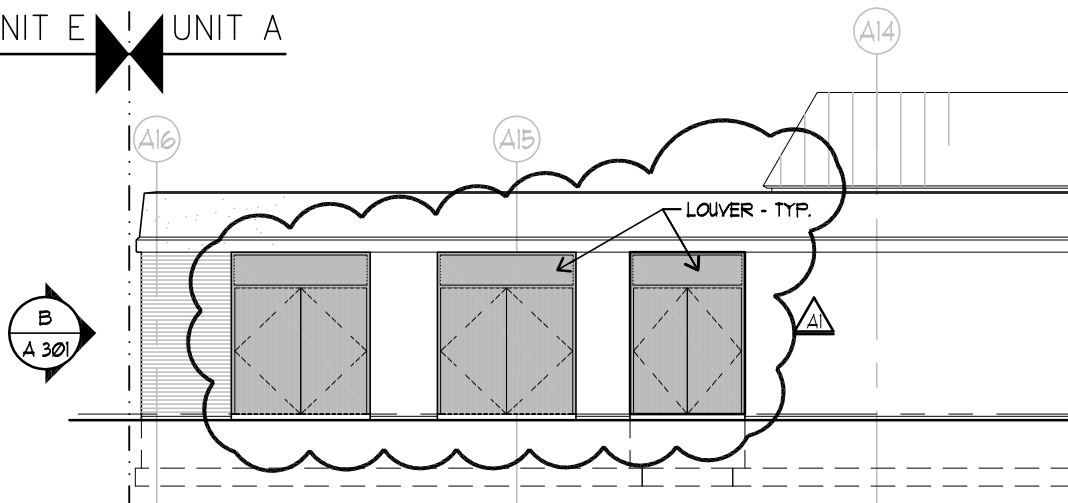

 **UNIT A WEST ELEVATION**
SCALE: 3/32" = 1'-0"

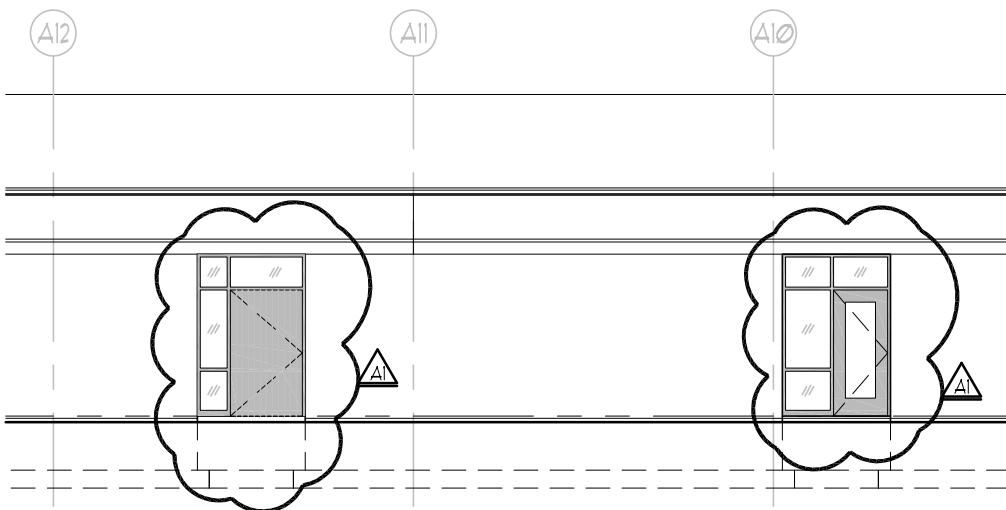

 **UNIT A WEST ELEVATION**
SCALE: 3/32" = 1'-0"

EXTERIOR ELEVATIONS

LOUIS E. LEGG MIDDLE SCHOOL
COLDWATER
COMMUNITY SCHOOLS

TowerPinkster
Making it real

© 2012 All rights reserved.
ADDENDUM NO.: 1
REFER TO DRAWING: A 301

A-9
APRIL 23, 2012
11-165.30

DOOR SCHEDULE

| NUMBER | DOOR ROOM | DOOR | | SIZE | FRAME | | DETAILS | | | GLASS | HDWR. SET | REMARKS | | |
|--------|-----------|------|-----------|------|-----------------|------------------|---------|------|------|----------|-----------|---------|-----|----------------|
| | | TYPE | MAT. FIN. | | ELEV. MAT. FIN. | FIN. | HEAD | JAMB | SILL | | | | | |
| A101 | A101 | - | B | ALUM | ANOD | 3'-0" x 1'-0" | F3 | ALUM | ANOD | H-3/A501 | J-1/A501 | G-1 | 10 | - |
| A105 | A105 | - | A | ALUM | ANOD | FR 3'-0" x 1'-0" | F5 | ALUM | ANOD | H-3/A501 | J-1/A501 | G-1 | 20 | - |
| A108 | A108 | - | A | ALUM | ANOD | FR 3'-0" x 1'-0" | F5 | ALUM | ANOD | H-3/A501 | J-1/A501 | G-1 | 20 | - |
| A119 | A119 | - | A | ALUM | ANOD | 4'-0" x 1'-0" | F3 | ALUM | ANOD | H-8/A501 | J-8/A501 | G-1 | 10 | - |
| A120 | A120 | - | A | ALUM | ANOD | FR 3'-0" x 1'-0" | F2 | ALUM | ANOD | H-7/A501 | J-7/A501 | G-1 | 30 | TRANSOM LOUVER |
| A121A | A121 | - | A | ALUM | ANOD | FR 3'-0" x 1'-0" | F2 | ALUM | ANOD | H-8/A501 | J-8/A501 | - | 40 | TRANSOM LOUVER |
| A121B | A121 | - | A | ALUM | ANOD | FR 3'-0" x 1'-0" | F2 | ALUM | ANOD | H-8/A501 | J-8/A501 | - | 50 | TRANSOM LOUVER |
| A122A | A122A | - | B | ALUM | ANOD | 3'-0" x 1'-0" | F3 | ALUM | ANOD | H-3/A501 | J-1/A501 | G-1 | 150 | - |
| A123 | A123 | - | B | ALUM | ANOD | FR 3'-0" x 1'-0" | F5 | ALUM | ANOD | H-3/A501 | J-1/A501 | G-1 | 60 | - |
| A124 | A124 | - | B | ALUM | ANOD | 3'-0" x 1'-0" | F3 | ALUM | ANOD | H-3/A501 | J-1/A501 | G-1 | 10 | - |
| A128 | A128 | - | B | ALUM | ANOD | 3'-0" x 1'-0" | F3 | ALUM | ANOD | H-3/A501 | J-1/A501 | G-1 | 10 | - |
| A131 | A131 | - | B | ALUM | ANOD | FR 3'-0" x 1'-0" | F5 | ALUM | ANOD | H-3/A501 | J-1/A501 | G-1 | 60 | - |
| A132 | A132 | - | B | ALUM | ANOD | 3'-0" x 1'-0" | F3 | ALUM | ANOD | H-3/A501 | J-1/A501 | G-1 | 10 | - |
| A139 | A139 | - | B | ALUM | ANOD | 3'-0" x 1'-0" | F4 | ALUM | ANOD | H-3/A501 | J-1/A501 | G-1 | 10 | - |
| A140 | A140 | - | B | ALUM | ANOD | 3'-0" x 1'-0" | F4 | ALUM | ANOD | H-3/A501 | J-1/A501 | G-1 | 10 | - |
| A142A | A142 | - | B | ALUM | ANOD | FR 3'-0" x 1'-0" | F8 | ALUM | ANOD | H-3/A501 | J-4/A501 | G-1 | 80 | - |
| A142B | A142 | - | B | ALUM | ANOD | FR 3'-0" x 1'-0" | F8 | ALUM | ANOD | H-3/A501 | J-4/A501 | G-1 | 90 | - |
| A142C | A142 | - | B | ALUM | ANOD | FR 3'-0" x 1'-0" | F8 | ALUM | ANOD | H-2/A501 | J-4/A501 | G-1 | 100 | - |
| A142D | A142 | - | B | ALUM | ANOD | FR 3'-0" x 1'-0" | F8 | ALUM | ANOD | H-2/A501 | J-4/A501 | G-1 | 110 | - |
| B100 | B100 | - | B | ALUM | ANOD | FR 3'-0" x 1'-0" | F6 | ALUM | ANOD | H-3/A501 | J-1/A501 | G-1 | 60 | - |
| B102A | B102 | - | B | ALUM | ANOD | FR 3'-0" x 1'-0" | F7 | ALUM | ANOD | H-3/A501 | J-4/A501 | G-1 | 60 | - |
| C100 | C100 | - | B | ALUM | ANOD | FR 3'-0" x 1'-0" | F6 | ALUM | ANOD | H-3/A501 | J-1/A501 | G-1 | 60 | - |
| C101 | C101 | - | B | ALUM | ANOD | FR 3'-0" x 1'-0" | F7 | ALUM | ANOD | H-2/A501 | J-2/A501 | G-1 | 120 | - |
| C102A | C102 | - | B | ALUM | ANOD | FR 3'-0" x 1'-0" | F7 | ALUM | ANOD | H-3/A501 | J-4/A501 | G-1 | 60 | - |
| D100 | D100 | - | B | ALUM | ANOD | FR 3'-0" x 1'-0" | F6 | ALUM | ANOD | H-3/A501 | J-1/A501 | G-1 | 60 | - |
| D102A | D102 | - | B | ALUM | ANOD | FR 3'-0" x 1'-0" | F9 | ALUM | ANOD | H-3/A501 | J-4/A501 | G-1 | 60 | - |
| D119 | D119 | - | B | ALUM | ANOD | 3'-0" x 1'-0" | F10 | ALUM | ANOD | H-1/A501 | J-4/A501 | G-1 | 130 | - |
| E100 | E100 | - | B | ALUM | ANOD | FR 3'-0" x 1'-0" | F5 | ALUM | ANOD | H-3/A501 | J-4/A501 | G-1 | 60 | - |
| E101A | E101 | - | B | ALUM | ANOD | FR 3'-0" x 1'-0" | F8 | ALUM | ANOD | H-3/A501 | J-3/A501 | G-1 | 90 | - |
| E101B | E101 | - | B | ALUM | ANOD | FR 3'-0" x 1'-0" | F8 | ALUM | ANOD | H-3/A501 | J-3/A501 | G-1 | 80 | - |
| E101C | E101 | - | B | ALUM | ANOD | FR 3'-0" x 1'-0" | F8 | ALUM | ANOD | H-2/A501 | J-2/A501 | G-1 | 110 | - |
| E101D | E101 | - | B | ALUM | ANOD | FR 3'-0" x 1'-0" | F8 | ALUM | ANOD | H-2/A501 | J-2/A501 | G-1 | 100 | - |
| E104 | E104 | - | B | ALUM | ANOD | FR 3'-0" x 1'-0" | F11 | ALUM | ANOD | H-6/A501 | J-6/A501 | G-1 | 140 | - |
| E104A | E104 | - | A | ALUM | PREFIN | FR 3'-0" x 1'-0" | F1 | ALUM | ANOD | H-9/A501 | J-9/A501 | - | 140 | - |
| E104B | E104 | - | A | ALUM | PREFIN | FR 3'-0" x 1'-0" | F1 | ALUM | ANOD | H-9/A501 | J-9/A501 | - | 140 | - |

DOOR SCHEDULE

LOUIS E. LEGG MIDDLE SCHOOL
COLDWATER
COMMUNITY SCHOOLS

TowerPinkster
Making it real

© 2012 All rights reserved.
ADDENDUM NO.: 1
REFER TO DRAWING: A 501

A-10
APRIL 23, 2012
11-165.30